

DO NOT SCALE

NOTES

EXISTING WALLS TO BE REMOVED SHOWN DOTTED

100x440x215mm DP CONCRETE PADSTONE INSTALLED BELOW BOTH STEEL BEAM SUPPORTS

CONTRACTOR TO EXPOSE EXISTING FLOOR JOISTS TO DETERMINE WHETHER EXISTING WALL BEING REMOVED IS LOADBEARING. IF FOUND NOT TO SUPPORT FLOOR JOISTS, STEEL BEAM CAN BE OMITTED

KEY

SP SPLICE CONNECTION (SEE CALCULATIONS FOR DETAIL)

50x150 C16 FLOOR JOISTS AT 400mm CRS INSTALLED OVER EXISTING CEILING JOISTS.

SD SMOKE DETECTOR

FD20 FIRE DOOR

REFERENCE DRAWINGS

REV	DATE	REVISION	OR	REVIEW
B	FEB 09	INC. BLD'G CONTROL COMMENTS	MN	
A	DEC 08	ISSUE FOR BUILDING REGS	MN	



client


project

title


scale As shown date NOV 08

originator MN reviewed by


drawing number rev

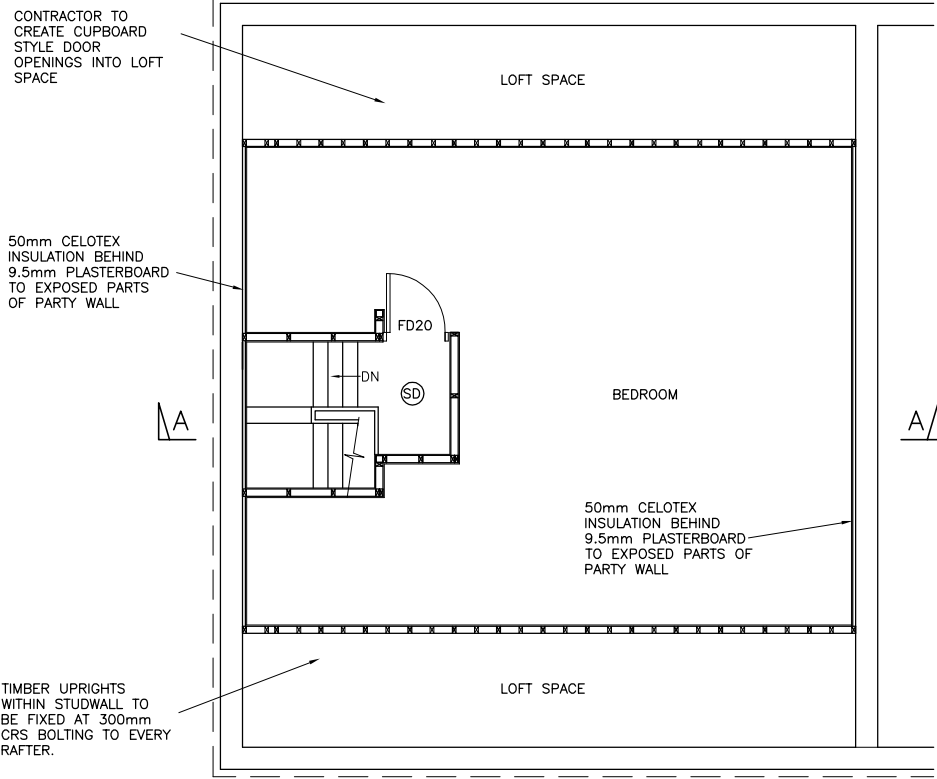


PROPOSED LOFT FLOOR PLAN Scale 1:50

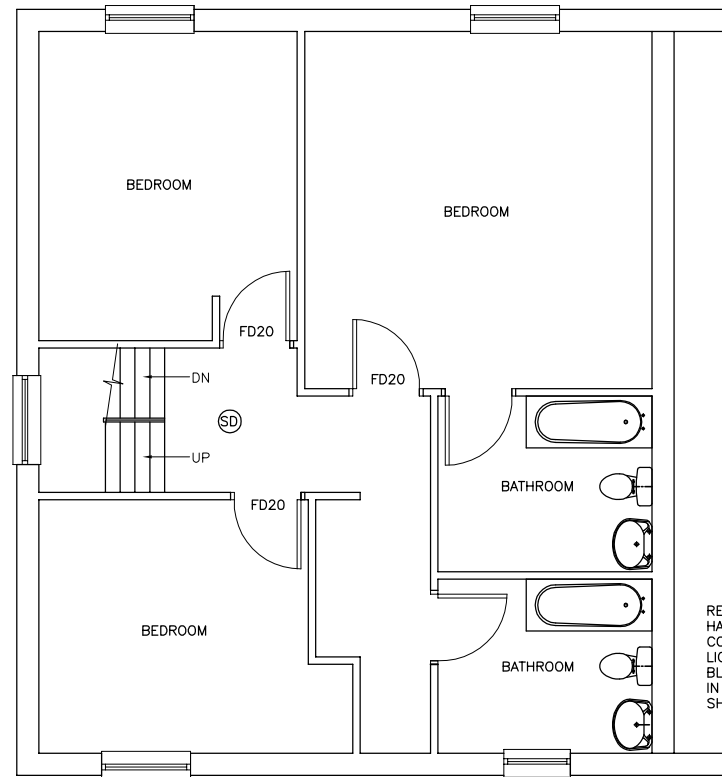


FIRST FLOOR PLAN Scale 1:50

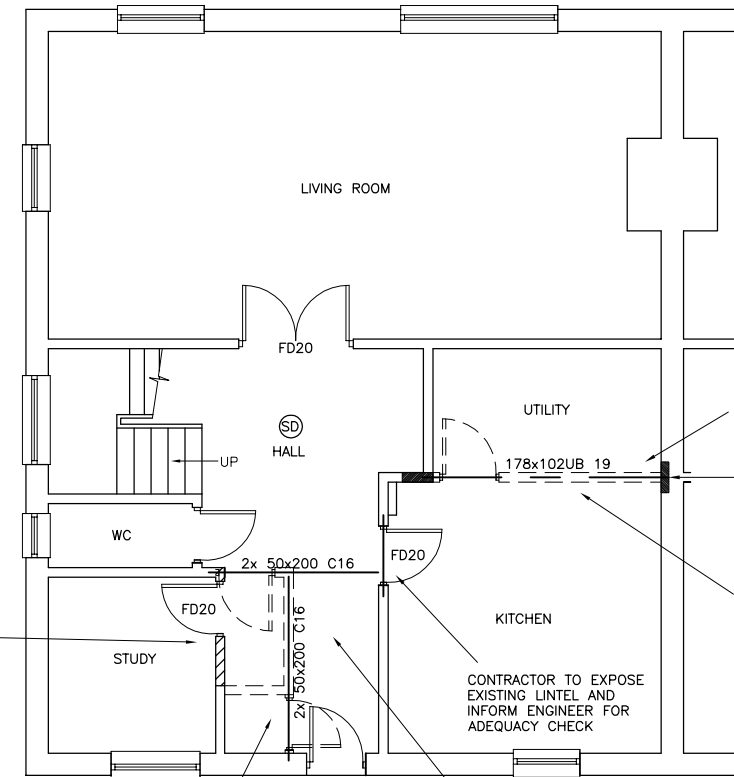

GROUND FLOOR PLAN Scale 1:50

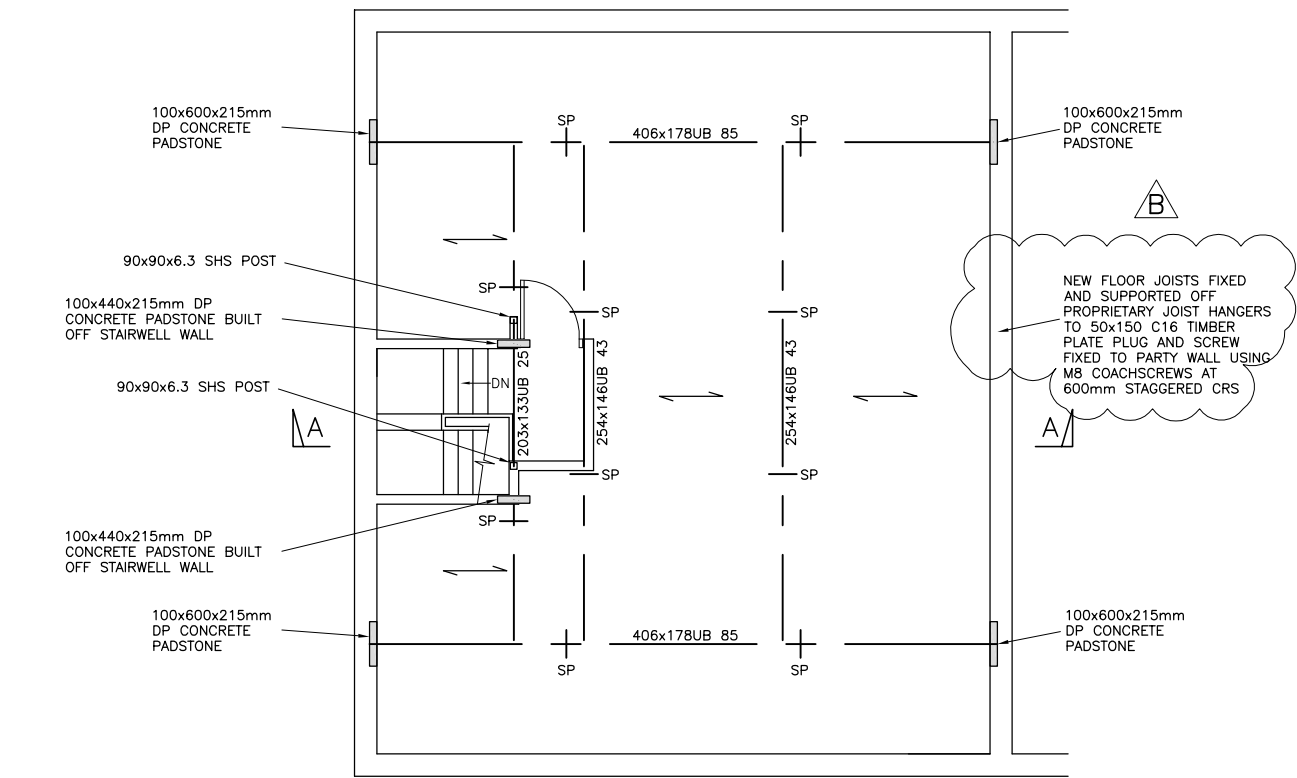

STEELWORK LAYOUT AT FLOOR LEVEL Scale 1:50

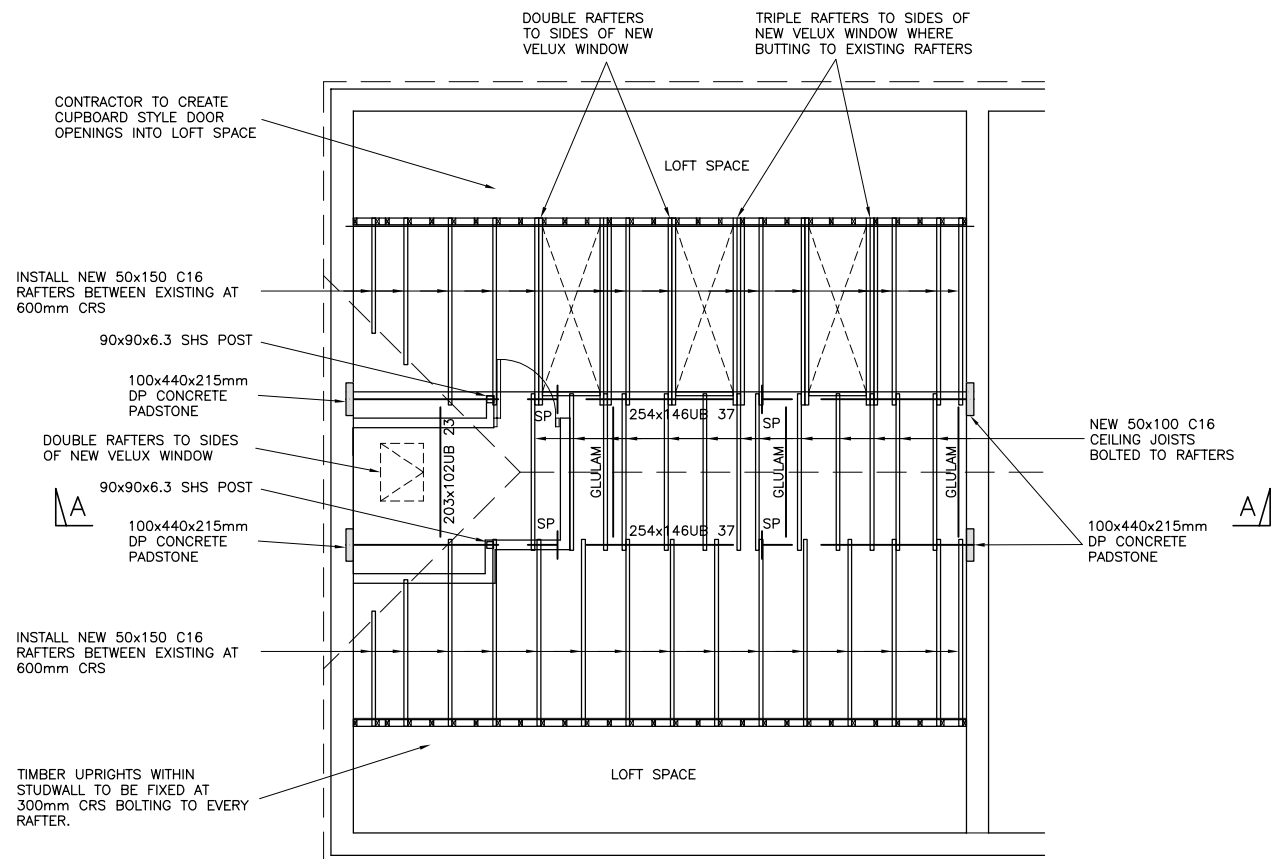

STEELWORK LAYOUT AT ROOF LEVEL Scale 1:50

ORIGINAL SCALE 0-100mm